


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

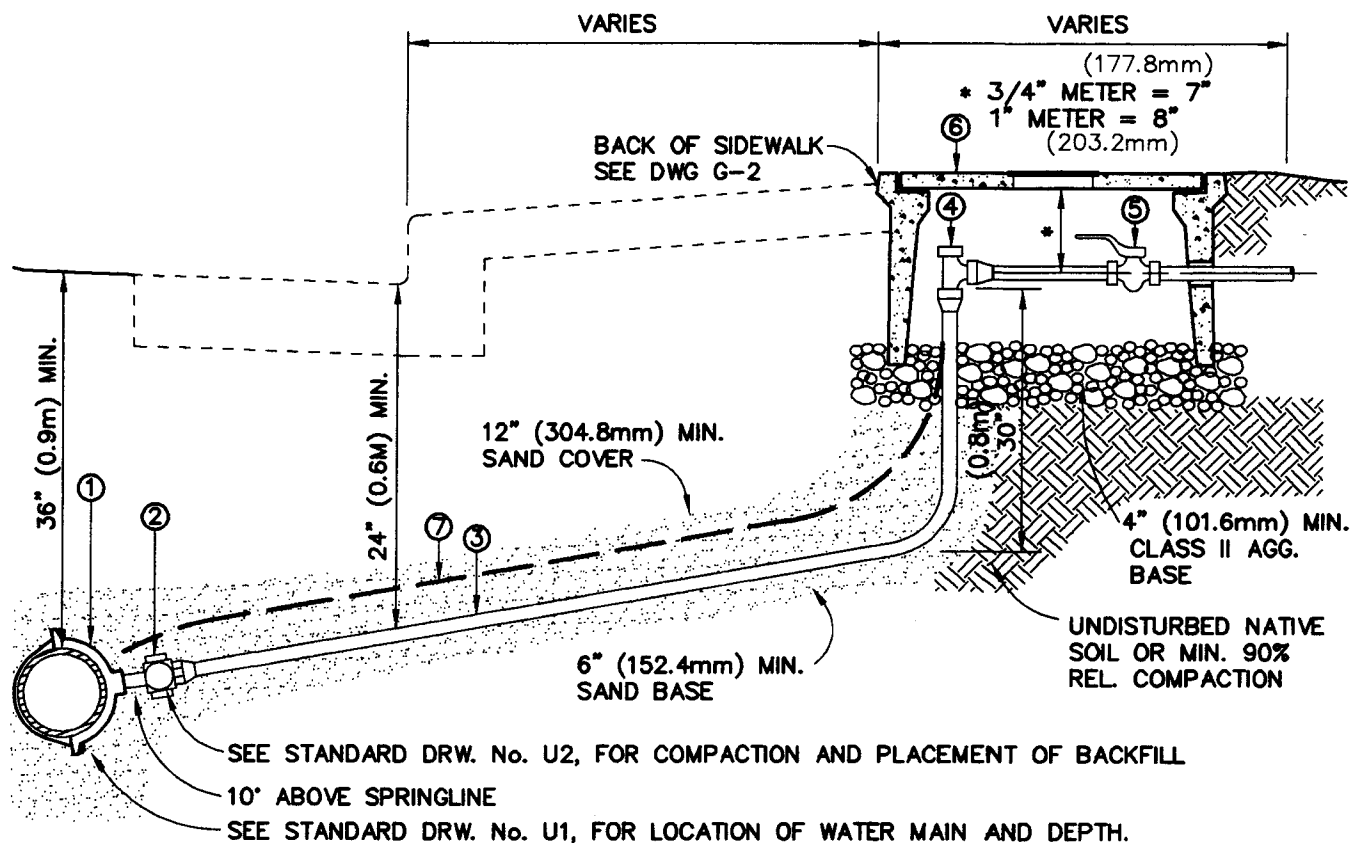

- ① SERVICE CLAMP: STAINLESS STEEL DOUBLE-STRAP (4 BOLTS) BRONZE SADDLE, FOR 1" TAP, AS LISTED OR EQUAL APPROVED BY THE CITY ENGINEER. MUELLER H-16100 SERIES OR JONES J-979 OR ROMAC 202 B5 FOR C-900 PVC
- ② CORPORATION STOP: 1" CORPORATION STOP, STRAIGHT COUPLING. MUELLER H-15050 OR FORD F-1000 OR JONES J-3401
- ③ SERVICE RISER: MIN. SERVICE TO METER IS 1" POLYETHYLENE (P.E.) COPPER TUBING SIZE.
- ④ ANGLE STOP VALVE: SHALL BE LOCKABLE IN OFF POSITION.
3/4" METER - 1"x3/4" FORD No. KV43-342W OR JONES J4201 OR EQUAL
1" METER - 1" FORD No. KV43-444W OR JONES 1963W OR APPROVED EQUAL
- ⑤ CUSTOMER SERVICE VALVE: INSTALL ON CUSTOMER SIDE.
3/4" - FORD BM - 13-242 OR JONES J1908, SIZE 3/4"x1" 1.P
1" - FORD BM - 13-444 OR JONES J1908
- ⑥ METER BOX: CHRISTY B-16G CONCRETE REINFORCED BOX AND COVER WITH CAST IRON READING LID, OR APPROVED EQUAL.
3/4" AND 1" METER - BROOKS No. 38H OR CHRISTY B-16G OR APPROVED EQUAL
- ⑦ LOCATOR WIRE: USE 12 GAUGE COPPER WIRE INSULATED FOR ALL SERVICE ASSEMBLIES. TIE TO LOCATOR WIRE ON MAIN LINE FROM ANGLE STOP VALVE.

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	1" (25.4mm) WATER SERVICE ASSEMBLY	G-6
FILE NAME: PR-G-6.DWG		